


BEST ROLLING DOORS, INC.

STEEL ROLL-UP DOORS MODELS S10-6065, S10-6565 & S10-100 LARGE MISSILE IMPACT / HVHZ

NON-SITE-SPECIFIC STRUCTURAL PERFORMANCE EVALUATION. A DESIGN PROFESSIONAL SHALL BE RESPONSIBLE FOR CERTIFYING THE APPLICATION OF THIS INFORMATION TO ANY SITE-SPECIFIC LOCATION.

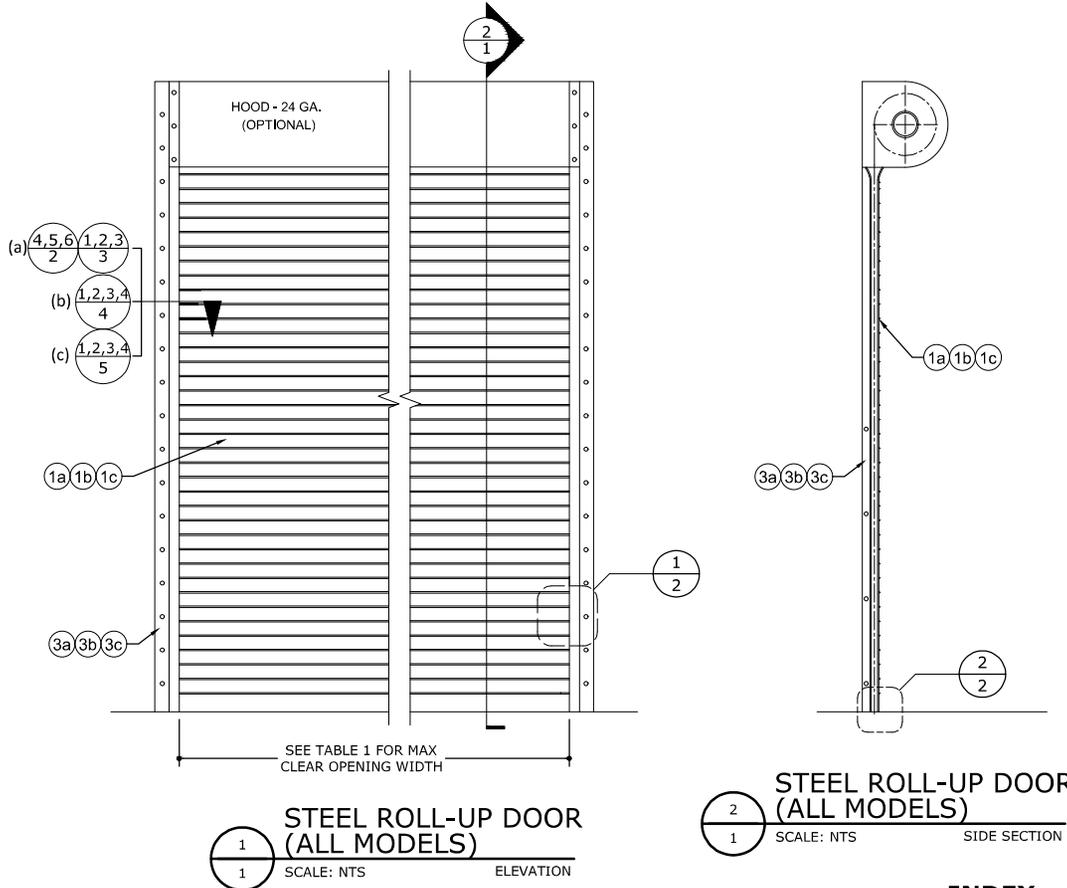

STEEL ROLL-UP DOOR (ALL MODELS)
SCALE: NTS
ELEVATION

STEEL ROLL-UP DOOR (ALL MODELS)
SCALE: NTS
SIDE SECTION

TABLE 1: MAXIMUM ALLOWABLE PRESSURE AND CLEAR OPENING WIDTH

MODEL #	MAXIMUM CLEAR OPENING WIDTH	MAXIMUM ALLOWABLE PRESSURE
(a) S10-6065	24'-1 1/2"	+60psf / -65psf
(b) S10-6565	30'-4 1/2"	+65psf / -65psf
(c) S10-100	30'-4 1/2"	+100psf / -100psf

INDEX


SHEET # | DESCRIPTION

- 1. COVER SHEET
 - 2-5. CONNECTION DETAILS
 - 6. SYSTEM COMPONENTS
- 6 TOTAL SHEETS

NOTE REGARDING USE OF THIS DOCUMENT & USE OUTSIDE FLORIDA:

NON-SITE-SPECIFIC STRUCTURAL PERFORMANCE EVALUATION. THIS PRODUCT EVALUATION IS VALID FOR USE IN FLORIDA ONLY. USE OF THIS EVALUATION REQUIRES A REVIEW & CERTIFICATION BY A LOCAL DESIGN PROFESSIONAL WHO SHALL BE RESPONSIBLE FOR THE PROPER ADAPTATION OF THIS GENERAL PERFORMANCE EVALUATION TO ANY SITE-SPECIFIC PROJECT. CONTACT THIS OFFICE AT ENGINEERINGEXPRESS.COM/QUOTE FOR ASSISTANCE WITH YOUR PROJECT-SPECIFIC NEEDS & FOR ADAPTATION & CERTIFICATION OF THIS DOCUMENT OUTSIDE OF FLORIDA.

FRANK BENNARDO, P.E.
PE# 0046549 CA# 9885



Digitally signed by
Frank Bennardo
Date: 2023.11.03
17:11:40 -04'00'

GENERAL NOTES:

- THE SYSTEM DESCRIBED HEREIN HAS BEEN DESIGNED AND TESTED IN ACCORDANCE WITH THE FLORIDA BUILDING CODE EIGHTH EDITION (2023) FOR USE INSIDE AND OUTSIDE THE HIGH VELOCITY HURRICANE ZONE, PER TAS 201, 202, AND 203 STANDARDS. SEE PRODUCT EVALUATION REPORT FOR MORE INFORMATION.
- POSITIVE AND NEGATIVE DESIGN PRESSURES CALCULATED FOR USE WITH THIS SYSTEM SHALL BE DETERMINED PER SEPARATE ENGINEERING IN ACCORDANCE WITH THE GOVERNING CODE. PRESSURE REQUIREMENTS AS DETERMINED IN ACCORDANCE WITH ASCE 7-22 AND THE FLORIDA BUILDING CODE SHALL BE LESS THAN OR EQUAL TO THE POSITIVE OR NEGATIVE DESIGN PRESSURE CAPACITY VALUES LISTED HEREIN (TABLE 1) FOR ANY ASSEMBLY AS SHOWN.
- ALLOWABLE DESIGN PRESSURES NOTED HEREIN ARE BASED ON MAXIMUM TESTED PRESSURES DIVIDED BY A 1.5 SAFETY FACTOR.
- THE SYSTEM DETAILED HEREIN IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SPECIFIC SITE. FOR SITE CONDITIONS DIFFERENT FROM THE CONDITIONS DETAILED HEREIN, A LICENSED ENGINEER OR REGISTERED ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE IN CONJUNCTION WITH THIS DOCUMENT. THESE INSTALLATION INSTRUCTIONS ARE PART OF A PRODUCT APPROVAL EVALUATION AND SHALL ONLY BE USED IN CONJUNCTION WITH THE EVALUATION REPORT SUBMITTED FOR THE SAME PRODUCT APPROVAL.
- SLATS TO BE A.S.T.M. A-653 GR 50 STRUCTURAL QUALITY STEEL WITH MIN. Fy = 50 KSI AND G-90 GALVANIZING PER A.S.T.M. A-653, OR A.I.S.I. 304 SERIES STAINLESS STEEL MANUFACTURED WITH A MINIMUM YIELD STRENGTH OF Fy = 50 KSI.
- WINDLOCKS SHALL BE 11 GA PLATED STEEL, A.S.T.M. A-1011
- ALL ASSEMBLY BOLTS TO BE S.A.E. GRADE 2 CADMIUM PLATED OR GALVANIZED STEEL.
- ALL RIVETS TO BE A.I.S.I. 1035 STEEL, CADMIUM PLATED, STAINLESS STEEL OR ZINC PLATED W/ Fy= 37,000 PSI.
- INSULATION MATERIAL SHALL BE EPS-EXPANDED POLYSTYRENE INSULATION MANUFACTURED BY DYPLAST PRODUCTS LLC COMPANY, MIAMI-DADE COUNTY NOTICE OF ACCEPTANCE # 17-1207.05 OR LATEST VERSION.
- DOOR MAY BE INSTALLED ON THE INSIDE OR OUTSIDE OF AN EXTERIOR WALL. DOOR IMPACTED ON BOTH SIDES.
- GUIDE DETAILS CAN BE USED IN ANY COMBINATION.
- ROLL-UP MECHANISM AND HOOD ASSEMBLY ARE NOT PART OF THIS APPROVAL.
- THIS DOCUMENT CONTAINS INFORMATION RELEVANT TO THE NECESSARY STRUCTURAL REQUIREMENTS OF THE SYSTEM INSTALLATION. COMPONENTS AND FASTENERS NOT REFERENCED WHICH ARE PART OF THE INTERNAL FABRICATION OF THE SPECIFIED SYSTEMS OR ASSEMBLIES SHALL BE PER MANUFACTURER PUBLISHED SPECIFICATIONS.
- PERMIT HOLDER SHALL VERIFY THE ADEQUACY OF THE EXISTING STRUCTURE TO WITHSTAND SUPERIMPOSED LOADS OUTLINED HEREIN.
- UNITS SHALL BE LABELED IN ACCORDANCE WITH THE FLORIDA BUILDING COMMISSION AND THE FLORIDA DEPARTMENT OF BUSINESS & PROFESSIONAL REGULATION SPECIFICATION.
- CONTRACTOR SHALL BE RESPONSIBLE TO INSULATE DISSIMILAR MATERIALS TO PREVENT ELECTROLYSIS.
- WATERPROOFING IS NOT PART OF THIS CERTIFICATION AND SHALL BE CERTIFIED BY OTHERS.

FL 10706.1



POSTAL ADDRESS:
2234 NORTH FEDERAL HWY # 7664
BOCA RATON, FL 33431
ENGINEERINGEXPRESS.COM

BEST ROLLING DOORS, INC.

9770 N.W. 79TH AVENUE
HIWALEAH GARDENS, FL
Phn. (305) 698-3550

STEEL ROLL-UP DOORS
FLORIDA BUILDING CODE EIGHTH EDITION (2023)
FLORIDA STATEWIDE APPROVAL (FSA FL#10706.1)

REMARKS	DATE	DRWN	CHKD
INT ISSUE	08/16/17	RVN	FLB
REC 2020 (21-30346)	01/25/21	JEM	FLB
REC 2023	09/29/23	AMZ	RS




COPYRIGHT ENGINEERING EXPRESS®
23-62056a

SCALE: NTS UNLESS NOTED

VISIT ECALC.IO/62056a SCAN HERE:

FOR HELPFUL RESOURCES, SITE SPECIFIC JOB ORDERING & MORE INFORMATION ABOUT THIS PRODUCT & RELATED SERVICES

c:\users\sam\engineering\express\production - documents\projects\23-23-62056 multiple products 2023 fbc update fl10706\work\drawings & cad\21-36346a -fl10706.1 - dwg_1.dwg
 11/13/2023 3:59 PM SAM

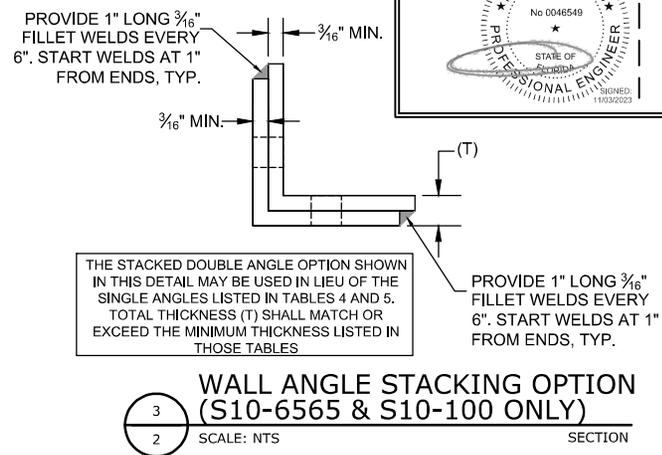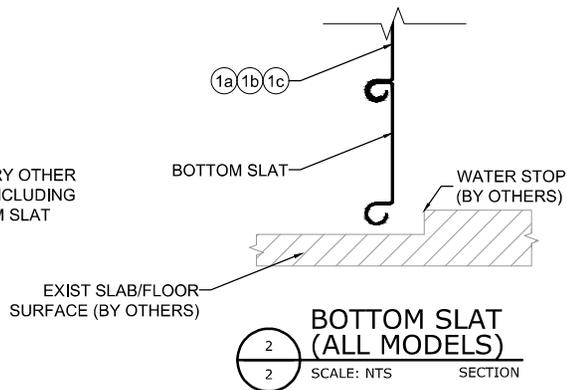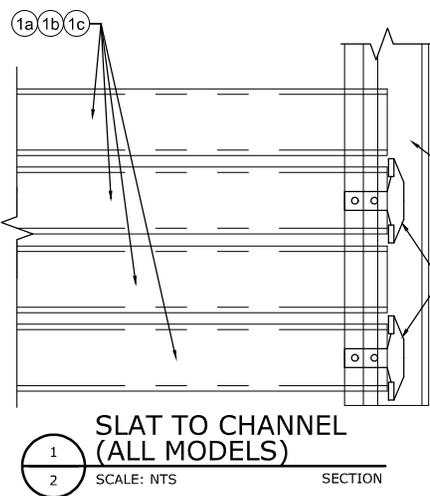

FRANK BENNARDO, P.E.
 PE# 0046549 CA# 9885

STATE OF FLORIDA
 PROFESSIONAL ENGINEER
 LICENSE No 0046549
 SIGNED: 1/13/2023




SPACE RESERVED FOR CERTIFYING ENGINEER'S DIGITAL OR PHYSICAL SEAL & DATE OF CERTIFICATION
 NOVEMBER 3, 2023

FL 10706.1

ENGINEERING EXPRESS

POSTAL ADDRESS:
 2234 NORTH FEDERAL HWY # 7664
 BOCA RATON, FL 33431
 ENGINEERINGEXPRESS.COM

**JAMB CONNECTIONS
 MODEL #S10-6065**

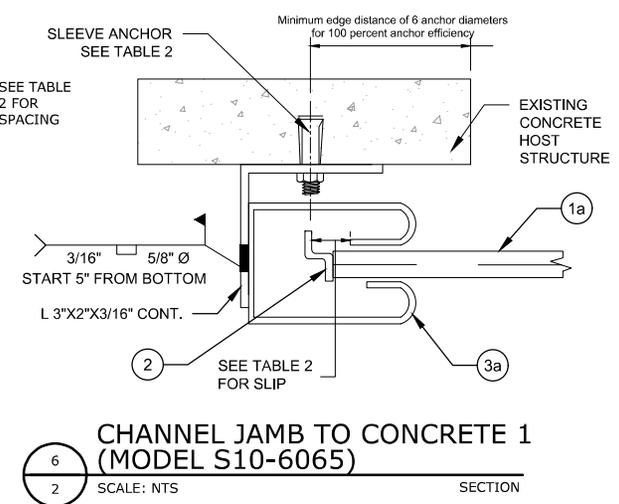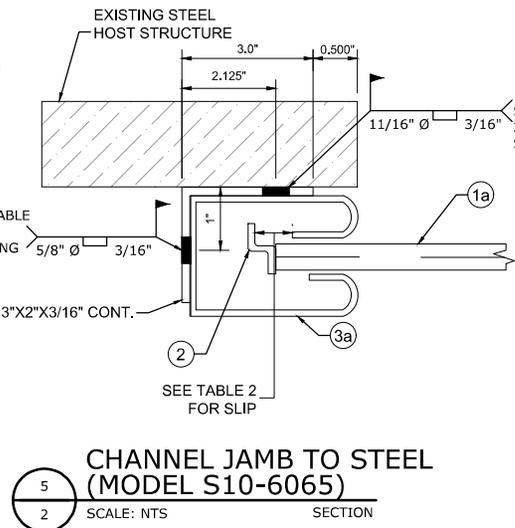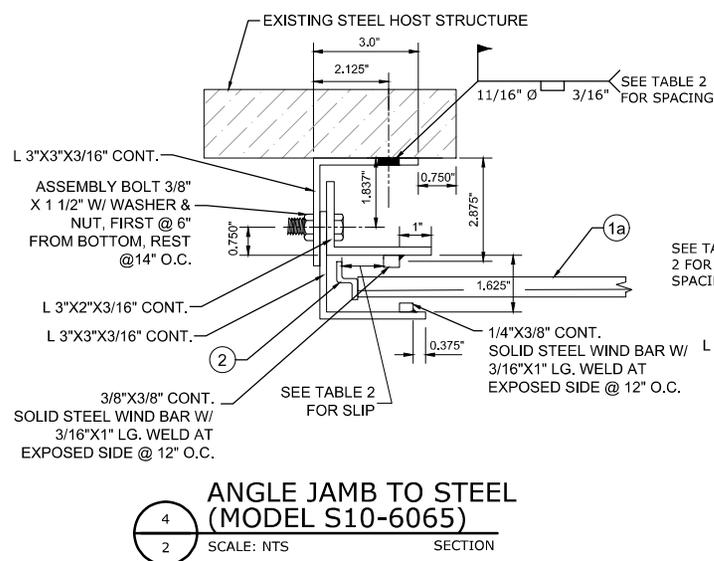

BEST ROLLING DOORS, INC.

9770 N.W. 79TH AVENUE
 HIALEAH GARDENS, FL
 Phn. (305) 698-3550

STEEL ROLL-UP DOORS

FLORIDA BUILDING CODE EIGHTH EDITION (2023)
 FLORIDA STATEWIDE APPROVAL (FSA FL#10706.1)

REMARKS	DATE
INT ISSUE	08/16/17
REV FCB	01/25/21
JEM FCB	09/29/23
AMZ RS	


23-62056a

SCALE: NTS UNLESS NOTED

2

JAMB CONNECTIONS MODEL #S10-6065 CONT'D


FRANK BENNARDO, P.E.
PE# 0046549 CA# 9885




SPACE RESERVED FOR
CERTIFYING ENGINEER'S
DIGITAL OR PHYSICAL SEAL
& DATE OF CERTIFICATION

NOVEMBER 3, 2023


c:\users\sam\engineering\express\production - documents\projects\23-23-62056 multiple products 2023 fbc update fl10706\work\drawings & cad\21-36346a -fl10706.1 - dwg - L.dwg 11/2/2023 3:59 PM SAM

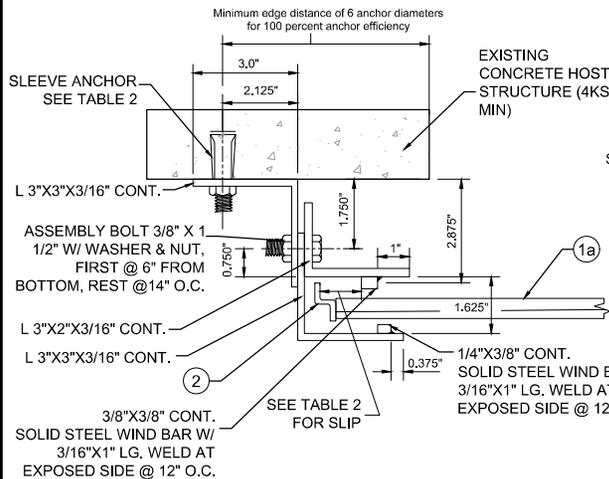

**ANGLE JAMB TO CONCRETE 1
(MODEL S10-6065)**

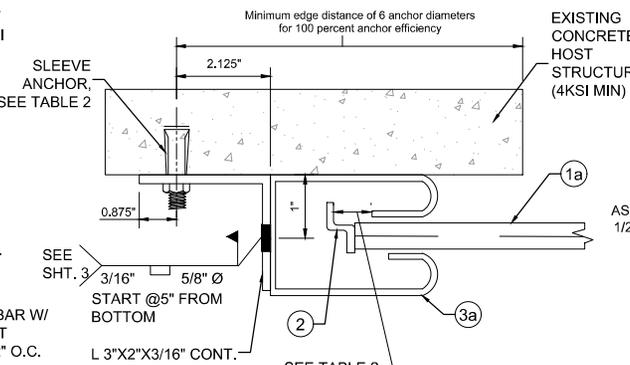

**CHANNEL JAMB TO CONCRETE 2
(MODEL S10-6065)**

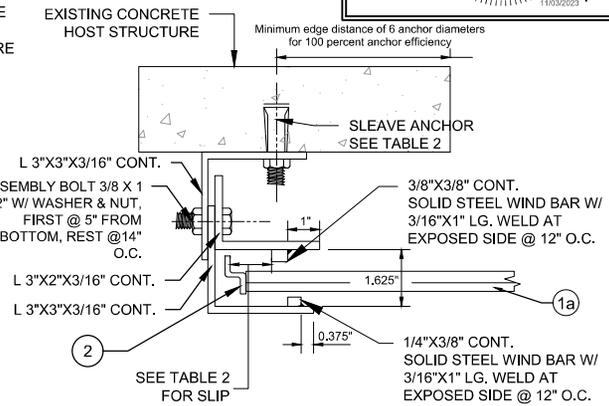

**ANGLE JAMB TO CONCRETE 2
(MODEL S10-6065)**

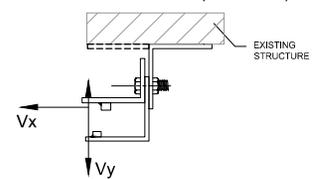


TABLE 2: MODEL #S10-6065 JAMB CONNECTIONS

DOOR OPENING WIDTH	SLIP EACH END	ASSEMBLY CARRIAGE BOLT	ANCHORS TO CONCRETE JAMB		FIELD WELD TO STEEL JAMB		
			ANGLE GUIDE	CHANNEL GUIDE	ANGLE GUIDE	CHANNEL GUIDE	
			HILTI KWIK BOLT 3 OR DYNABOLT SLEEVE ANCHOR*	HILTI KWIK BOLT 3 OR DYNABOLT SLEEVE ANCHOR*	PLUG WELD WALL ANGLE TO JAMB	PLUG WELD WALL ANGLE TO JAMB	PLUG WELD CHANNEL TO WALL ANGLE
dia. x embedment x spacing	dia. x embedment x spacing						
24' 1-1/2"	1.00"	1/2"-13x1-1/2" @14" o.c.	3/4" x 6-1/2" @4-3/4" o.c.	3/4" x 6-1/2" @10" o.c.	11/16" dia. x 3/16" @5-1/2" o.c.	11/16" dia. x 3/16" @14" o.c.	5/8" x 3/16" @4" o.c.
20'-0"	1.00"	1/2"-13x1-1/2" @14" o.c.	3/4" x 6-1/2" @8" o.c.	3/4" x 6-1/2" @13" o.c.	11/16" dia. x 3/16" @7-1/2" o.c.	11/16" dia. x 3/16" @14" o.c.	5/8" x 3/16" @5" o.c.
16'-0"	1.00"	1/2"-13x1-1/2" @14" o.c.	3/4" x 6-1/2" @13" o.c.	3/4" x 4-3/4" @14" o.c. or 5/8" x 4" @13" o.c.	11/16" dia. x 3/16" @11" o.c.	11/16" dia. x 3/16" @14" o.c.	5/8" x 3/16" @7" o.c.
14'-0"	1.00"	1/2"-13x1-1/2" @14" o.c.	3/4" x 4-3/4" @14" o.c. or 5/8" x 5-1/2" @12" o.c.	3/4" x 3-1/4" @14" o.c. or 5/8" x 4" @14" o.c.	11/16" dia. x 3/16" @14" o.c.	11/16" dia. x 3/16" @14" o.c.	5/8" x 3/16" @8-1/2" o.c.
12'-0"	0.50"	1/2"-13x1-1/2" @14" o.c.	3/4" x 3-1/4" @8-1/2" o.c. or 5/8" x 5-1/2" @11" o.c.	3/4" x 3-1/4" @14" o.c. or 5/8" x 5-1/2" @14" o.c.	11/16" dia. x 3/16" @13" o.c.	11/16" dia. x 3/16" @14" o.c.	5/8" x 3/16" @9" o.c.
10'-0"	0.50"	1/2"-13x1-1/2" @14" o.c.	3/4" x 3-1/4" @14" o.c. or 5/8" x 5-1/2" @14" o.c.	3/4" x 3-1/4" @14" o.c. or 5/8" x 5-1/2" @14" o.c.	11/16" dia. x 3/16" @14" o.c.	11/16" dia. x 3/16" @14" o.c.	5/8" x 3/16" @13" o.c.

* FIRST AND LAST ANCHOR SHALL BE 7" MAXIMUM FROM END OF ANGLE

LOAD DIAGRAM (ANGLES)



LOAD DIAGRAM (CHANNEL)

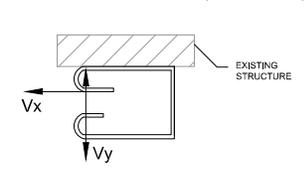


TABLE 3: MODEL #S10-6065 JAMB REACTIONS

DOOR OPENING WIDTH	SLIP EACH END	C CHANNEL OR ANGLE GUIDES			
		POSITIVE WIND Vx plf	POSITIVE WIND Vy plf	NEGATIVE WIND Vx plf	NEGATIVE WIND Vy plf
24' 1-1/2"	1.00"	3486	727	3784	787
20'-0"	1.00"	2574	602	2799	653
16'-0"	1.00"	1738	482	1900	523
14'-0"	1.00"	1329	422	1461	457
12'-0"	0.50"	1434	363	1582	393
10'-0"	0.50"	858	302	971	327

FL 10706.1

EX ENGINEERING EXPRESS
 POSTAL ADDRESS:
 2234 NORTH FEDERAL HWY # 7664
 BOCA RATON, FL 33431
 ENGINEERINGEXPRESS.COM

BEST ROLLING DOORS, INC.
 9770 N.W. 79TH AVENUE
 HIALEAH GARDENS, FL
 Phn. (305) 698-3550
 STEEL ROLL-UP DOORS
 FLORIDA BUILDING CODE EIGHTH EDITION (2023)
 FLORIDA STATEWIDE APPROVAL (FSA FL#10706.1)

DATE	DRWN	CHKD	DATE	INT	ISSUE
08/16/17	RVN	FLB	01/25/21	JEM	FLB
09/29/23	AMZ	RS	09/29/23	AMZ	RS

REMARKS: COPYRIGHT ENGINEERING EXPRESS®

23-62056a

SCALE: NTS UNLESS NOTED



